


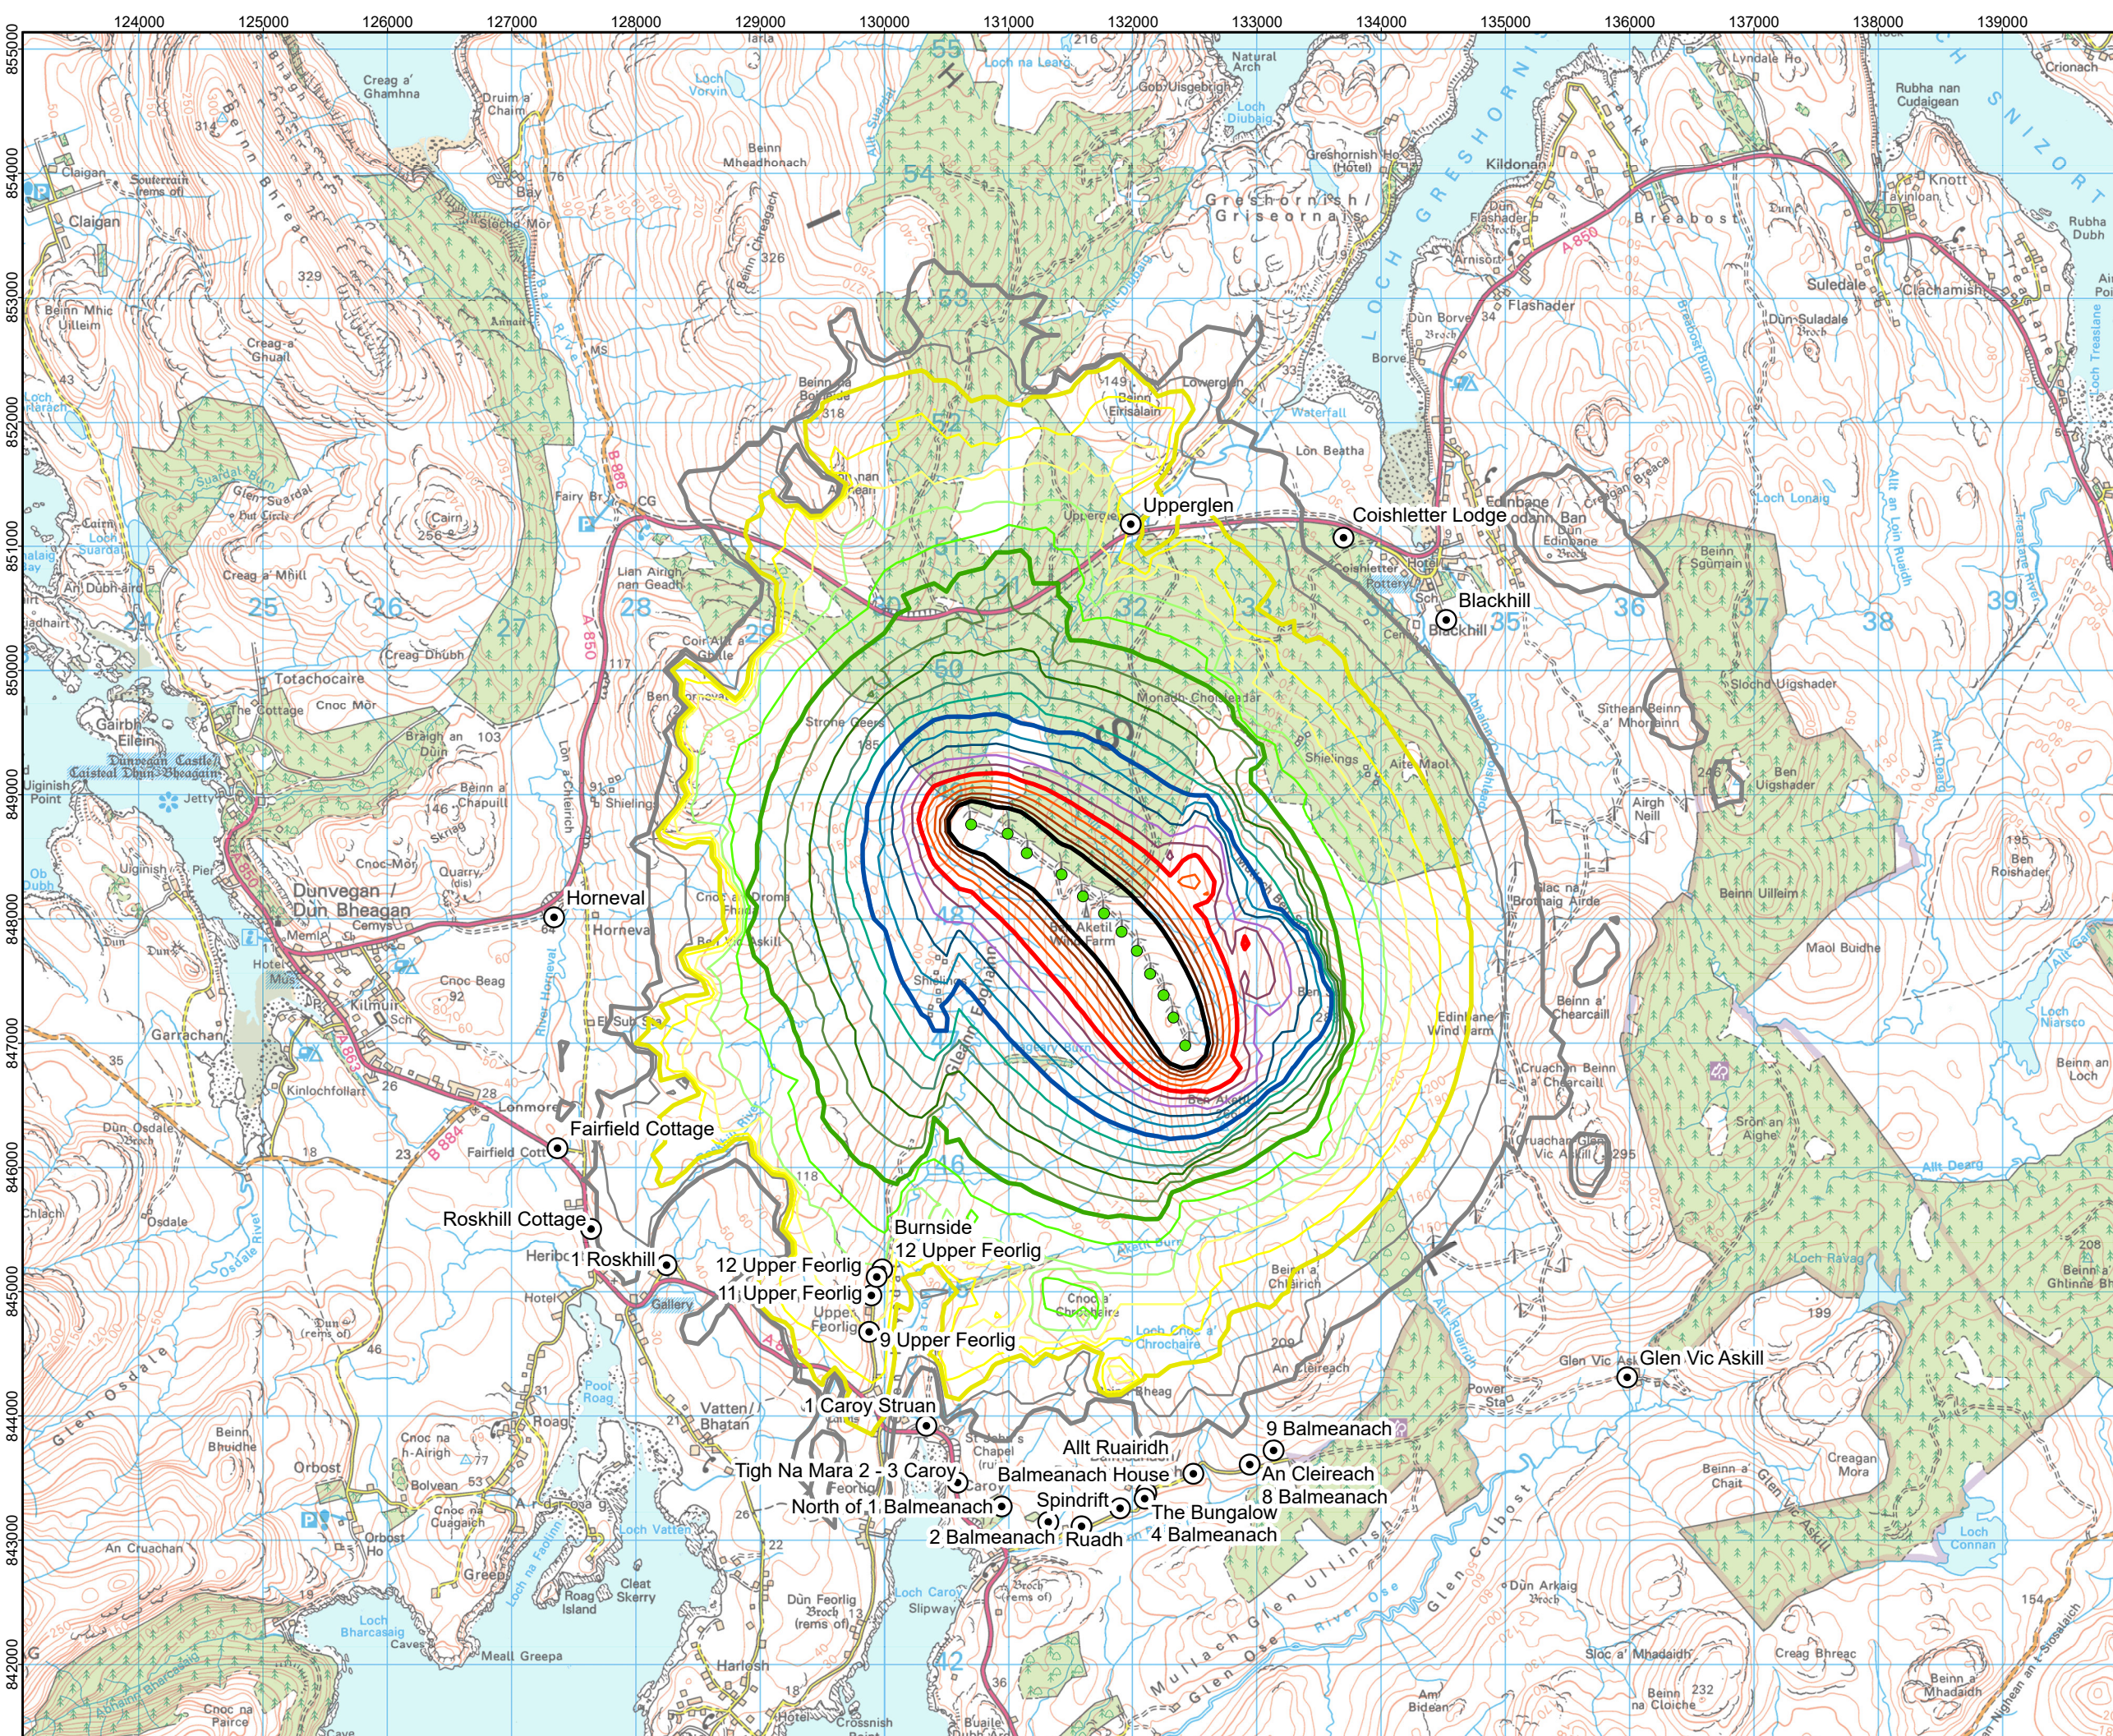


Legend:

- Existing Ben Aketil Turbine Layout
- Noise sensitive receptor locations

Predicted Noise Level (dB LA90)

- 28
- 30
- 35
- 40
- 45
- 50

Coordinate System: British National Grid
Projection: Transverse Mercator
Datum: OSGB 1936
Units: Meter

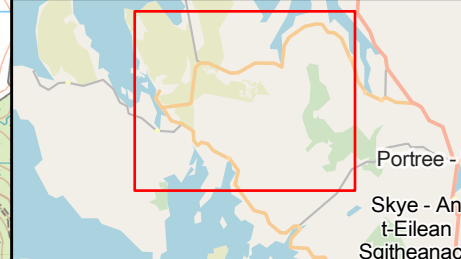

Rev	Date	Description	Drm	Chk	App
01	28/04/2023	Revised Logo	DL	DB	DB
00	02/03/2023	First Draft	DL	DB	DB

Ben Aketil Wind Farm



TITLE: Figure 12.1:
Predicted operational noise levels for
maximum sound power level –
Ben Aketil existing

ID:P663617_EIA_663617_Noise_BA_Existing

